


8 Sourcing Output Base Module 1791D-0B8P

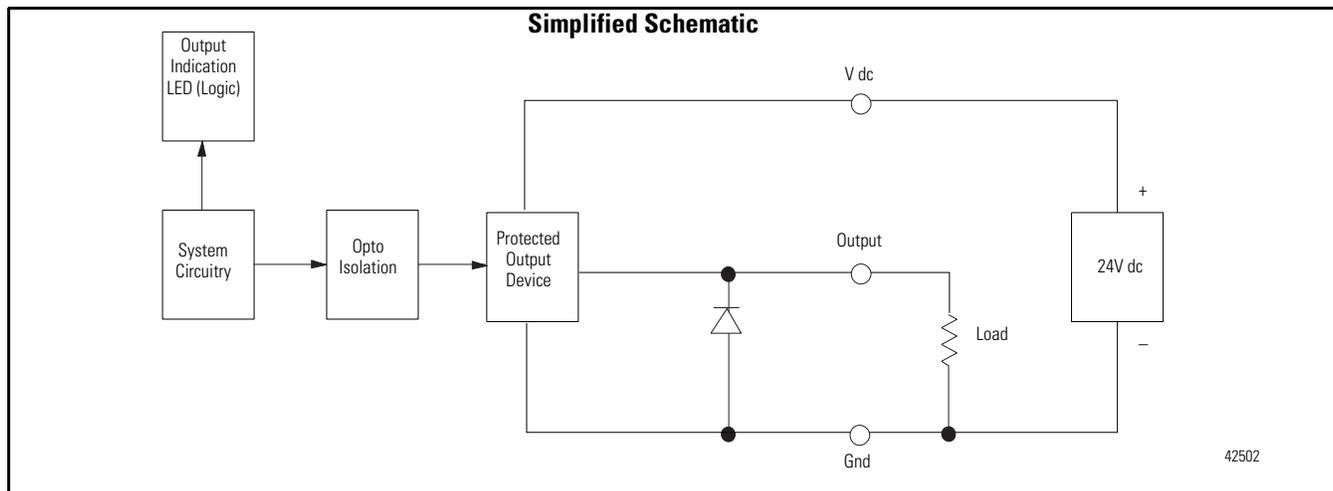

The CompactBlock base module I/O is exchanged with the master through a poll, change-of-state, or cyclic connection.

Polled - a master initiates communication by sending its polled I/O message to the CompactBlock module. The module consumes the message, updates any outputs, and produces a response. If any inputs are present, the response will contain the input data.

Change-of-state - productions occur when an input changes. If no input change occurs within the expected packet rate, a heartbeat production occurs. This heartbeat production tells the scanner module that the CompactBlock I/O module is alive and ready to communicate. Consumption occurs when data changes and the master produces new output data to the I/O block.

Cyclic - allows configuration of the block as an I/O client. The block will produce and consume its I/O cyclically at the rate configured.

The module consumes 1 byte for every 8 outputs. When an expansion module is connected, an additional byte will be returned indicating the health of the expansion module.

The following table contains connection sizes for this module:

Module	I/O Points	Produce (input bytes)	Consume (output bytes)
1791D-0B8P	8 outputs	0	1
1791D-0B8P with expansion output	24 outputs	1	3
1791D-0B8P with expansion input	8 output/ 16 inputs	3	1

Refer to the tables below for the word/bit definitions.


Bit	07	06	05	04	03	02	01	00
Consumes 0	07	06	05	04	03	02	01	00

Word	Bit	Description
Consumes 0	00-07	Output bits - when the bit is set (1), the output will be turned on. Bit 00 corresponds to output 00, bit 01 corresponds to output 01, bit 02 to output 02, bit 03 to output 03, etc.

The DeviceNet Network uses advanced network technology, producer/consumer communication, to increase network functionality and throughput. Visit our Web site at <http://www.ab.com/networks> for producer/consumer technology information and updates.

Wiring Connections

Output Wiring Diagram for 1791D-0B8P

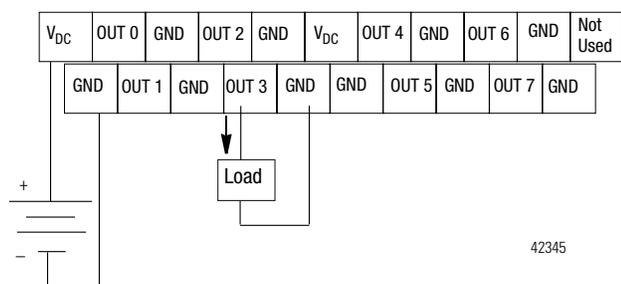

Specifications

Sourcing Outputs	
Outputs per Block	8
On-state Voltage Range	10 - 30V dc
On-state Voltage Drop	0.5V dc @ rated current
On-state Current	0.5A maximum
Off-state Leakage	1.0mA maximum
Module Current (all outputs)	4.0A maximum
Surge Current - for 10ms, repeatable every 2 s	1.0A maximum

General Specifications	
Indicators	Mod/Net status - red/green Logic status - green I/O status - yellow
Communication Rate Thick Cable	125Kbps @ 500m (1600ft) 250Kbps @ 200m (600ft) 500Kbps @ 100m (330ft)
Flat Media	125Kbps @ 420m (1230ft) 250Kbps @ 200m (490ft) 500Kbps @ 75m (245ft)
Isolation I/O to DeviceNet I/O group-to-group I/O group-to-logic	500V ac 500V ac 500V ac
DeviceNet Power Voltage Current	11V - 25 V dc 200mA maximum (with expansion)
Auxiliary Power Voltage Current	10 - 30V dc 4A maximum
Base Module Dimensions	150mm X 48mm X 38mm 5.91 in X 1.9 in X 1.5 in
Environmental Conditions Operating Temperature Non-Operating Temperature Relative Humidity Operating Shock Non-operating Shock Vibration	0 to 60°C (32 to 140°F) -40 to 85°C (-40 to 185°F) 5-95% non-condensing 30g 50g tested 5g @ 10-500Hz per IEC 68-2-6
Conductors Wire Size Category	14 gauge (2mm ²) stranded maximum 3/64 inch insulation maximum 2 ^{1, 2}
Product Certifications	UL, UL Hazardous Class I, Div 2, Groups A, B, C, D. C-UL, C-UL Hazardous Class I, Div 2, Groups A, B, C, D. CE marked for all applicable directives
Enclosure	IEC IP20

¹ Use this conductor category information for planning conductor routing as described in the system level installation manual.

² Refer to, Programmable Controller Wiring and Grounding Guidelines, publication 1770-4.1.